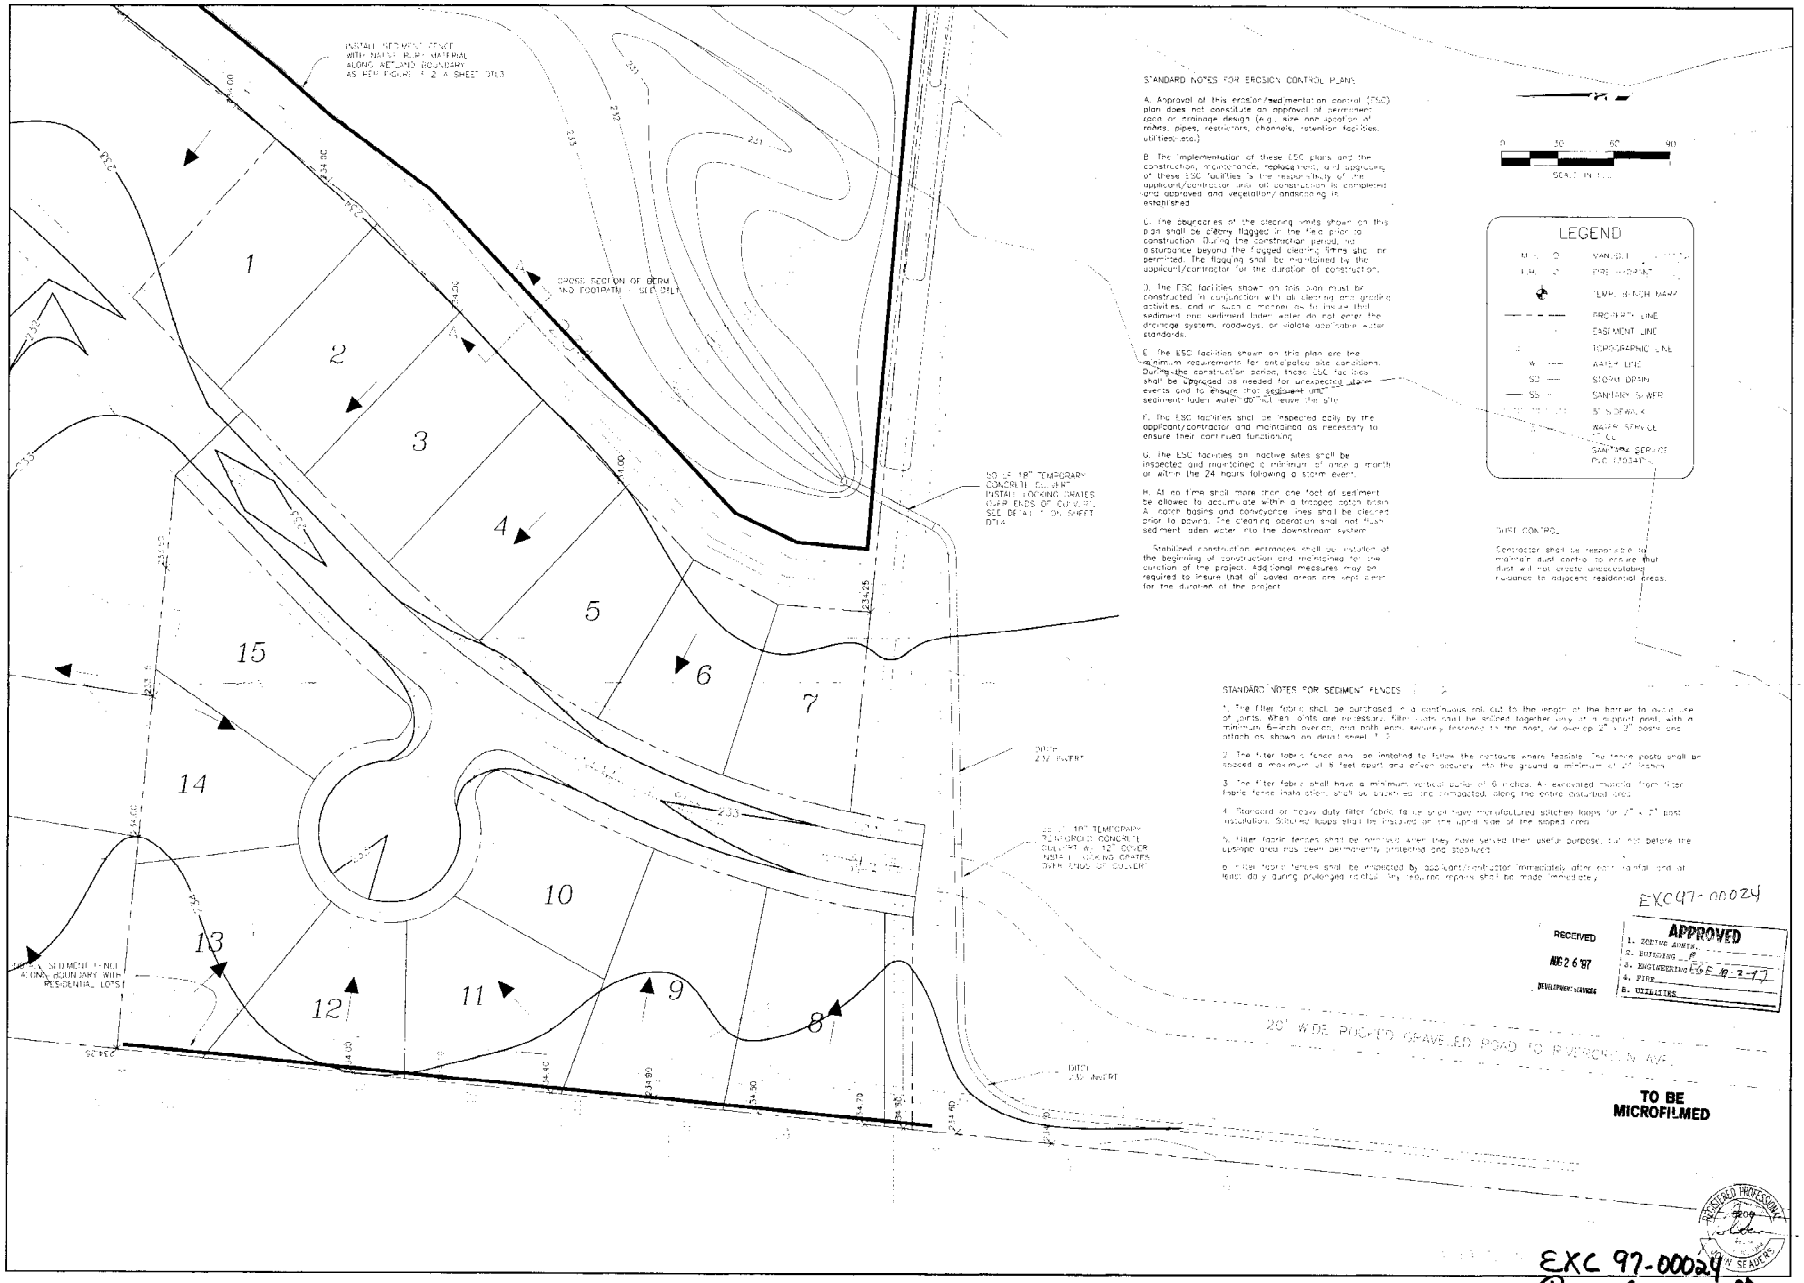

STANDARD NOTES FOR EROSION CONTROL PLANS

A. Approval of this erosion/sedimentation control (ESC) plan does not constitute an approval of permanent road or drainage design (e.g., size and location of roads, pipes, restrictors, channels, retention facilities, utilities, etc.).

B. The implementation of these ESC plans and the construction, maintenance, replacement, and upgrading of these ESC facilities is the responsibility of the applicant/contractor until all construction is completed and approved and vegetation/landscaping is established.

C. The boundaries of the clearing limits shown on this plan shall be clearly flagged in the field prior to construction. During the construction period, no disturbance beyond the flagged clearing limits shall be permitted. The flagging shall be maintained by the applicant/contractor for the duration of construction.

D. The ESC facilities shown on this plan must be constructed in conjunction with all clearing and grading activities, and in such a manner as to insure that sediment and sediment laden water do not enter the drainage system, roadways, or violate applicable water standards.

E. The ESC facilities shown on this plan are the minimum requirements for anticipated site conditions. During the construction period, these ESC facilities shall be upgraded as needed for unexpected storm events and to ensure that sediment and sediment laden water do not leave the site.

F. The ESC facilities shall be inspected daily by the applicant/contractor and maintained as necessary to ensure their continued functioning.

G. The ESC facilities on inactive sites shall be inspected and maintained a minimum of once a month or within the 24 hours following a storm event.

H. At no time shall more than one foot of sediment be allowed to accumulate within a trapped catch basin. All catch basins and conveyance lines shall be cleaned prior to paving. The cleaning operation shall not flush sediment laden water into the downstream system.

Stabilized construction entrances shall be installed at the beginning of construction and maintained for the duration of the project. Additional measures may be required to insure that all paved areas are kept clean for the duration of the project.

DUST CONTROL

Contractor shall be responsible for maintaining dust control to ensure that dust will not create unreasonable nuisance to adjacent residential areas.

STANDARD NOTES FOR SEDIMENT FENCES

1. The filter fabric shall be purchased in a continuous roll cut to the length of the barrier to avoid use of joints. When joints are necessary, filter cloth shall be spliced together only at a support post, with a minimum 6-inch overlap, and both ends securely fastened to the post, or overlap 2" x 2" posts and attach as shown on detail sheet T.2.

2. The filter fabric fence may be installed to follow the contours where feasible. The fence posts shall be spaced a maximum of 6 feet apart and driven securely into the ground a minimum of 20 inches.

3. The filter fabric shall have a minimum vertical burial of 6 inches. All excavated material from filter fabric fence installation shall be backfilled and compacted along the entire downhill area.

4. Standard or heavy duty filter fabric fence shall have manufactured stitched loops for 2" x 2" post installation. Stitched loops shall be installed on the uphill side of the spaced area.

5. Filter fabric fences shall be removed when they have served their useful purpose, but not before the upslope area has been permanently protected and stabilized.

6. Filter fabric fences shall be inspected by applicant/contractor immediately after each rainfall and at least daily during prolonged rainfall. Any required repairs shall be made immediately.

EXC97-00024

RECEIVED
NOV 26 '97
DEVELOPMENT SERVICES

APPROVED
1. ZONING ADMIN.
2. BUILDING
3. ENGINEERING
4. FIRE
5. UTILITIES

TO BE MICROFILMED

REGISTERED PROFESSIONAL ENGINEER
JOHN SEAUCHE

EXC 97-00024
RIVERGREEN 3RD ADD PH 1A

REVISIONS	BY

COON FAMILY LIMITED PARTNERSHIP
2973 SE SUMMERFIELD DR.
CORVALLIS, OR 97333
(541) 753-1102

Rivergreen 3rd Add. Phase IA

CORVALLIS, OREGON

EROSION CONTROL\GRADING PLAN

ENGINEERING AND DESIGN BY:
MSS INC
531 SW 4th
CORVALLIS, OR 97333
(541) 753-1320

MARCH 1997
1" = 30'
koo/drr
22695.1E

T4

08/19/97 G:\22695\TE 14:49:34.JF