



ELECTRICAL
CONSTRUCTION CO.

ALBANY REGIONAL OFFICE

Craig Perkins
Electrical Inspector
Developmental Services
City of Corvallis
501 SW Madison
P.O. Box 1083
Corvallis, OR 97339-1083

September 05, 2001

**RE: EXISTING SERVICE CONDUCTORS AND UTILITY DROP LOCATED
AT 126 SW 4th ST., CORVALLIS (NOW 116 to 134, INCLUSIVE, 4th ST.)**

REF: CITY OF CORVALLIS PERMIT NUMBER ELP-00-00894

Dear Sir:

During a recent inspection there was discussion regarding the service conductors. This letter will serve to summarize that discussion.

1. The horizontal conductors from the transformer bank located in the alley at the rear of the property to the weatherhead constitute an 'existing condition' and are the responsibility of the utility.
2. The work performed by EC Co. from the weatherhead on the roof to the distribution bus located in the basement was performed to correct a deficiency.
3. The horizontal utility conductors were undisturbed except for the disconnection and reconnection by the utility for the repair work.

In regard to the safety concerns that you expressed, we propose the following:


4. As requested, an inspection of the utility service conductors was made. The conductors appear to be in good condition with no cracks or splitting of the insulation material or other exposure of the metallic conductor. The insulation material on the utility splices was substantially increased using listed materials and installed in a Code-compliant manner.
5. Signage of durable construction bearing the words 'DANGER – HIGH VOLTAGE' has been permanently affixed in such a manner as to be readily visible to any individual on the roof.

6. The existing roof access ladder shall be removed at the conclusion of the project to limit access to unauthorized persons.


To complete our project documentation, we request that you acknowledge this letter as approved, approved with exception(s) taken, or disapproved. Your cooperation in this matter is greatly appreciated.

If there are any questions that you might have regarding the issues stated above, please feel free to call me at any time.

Sincerely,

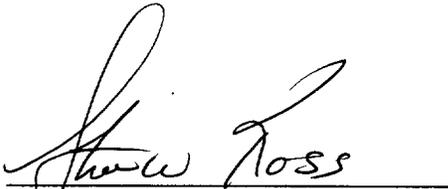

Steve Ross, Service Manager
EC Company, Inc.

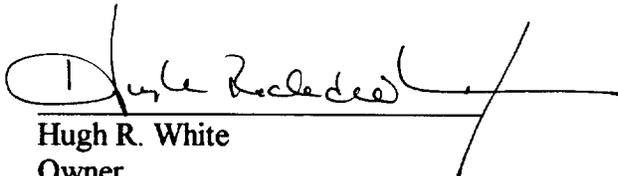

Hugh R. White
Owner
126 SW 4th St., Corvallis, OR

cc:

File