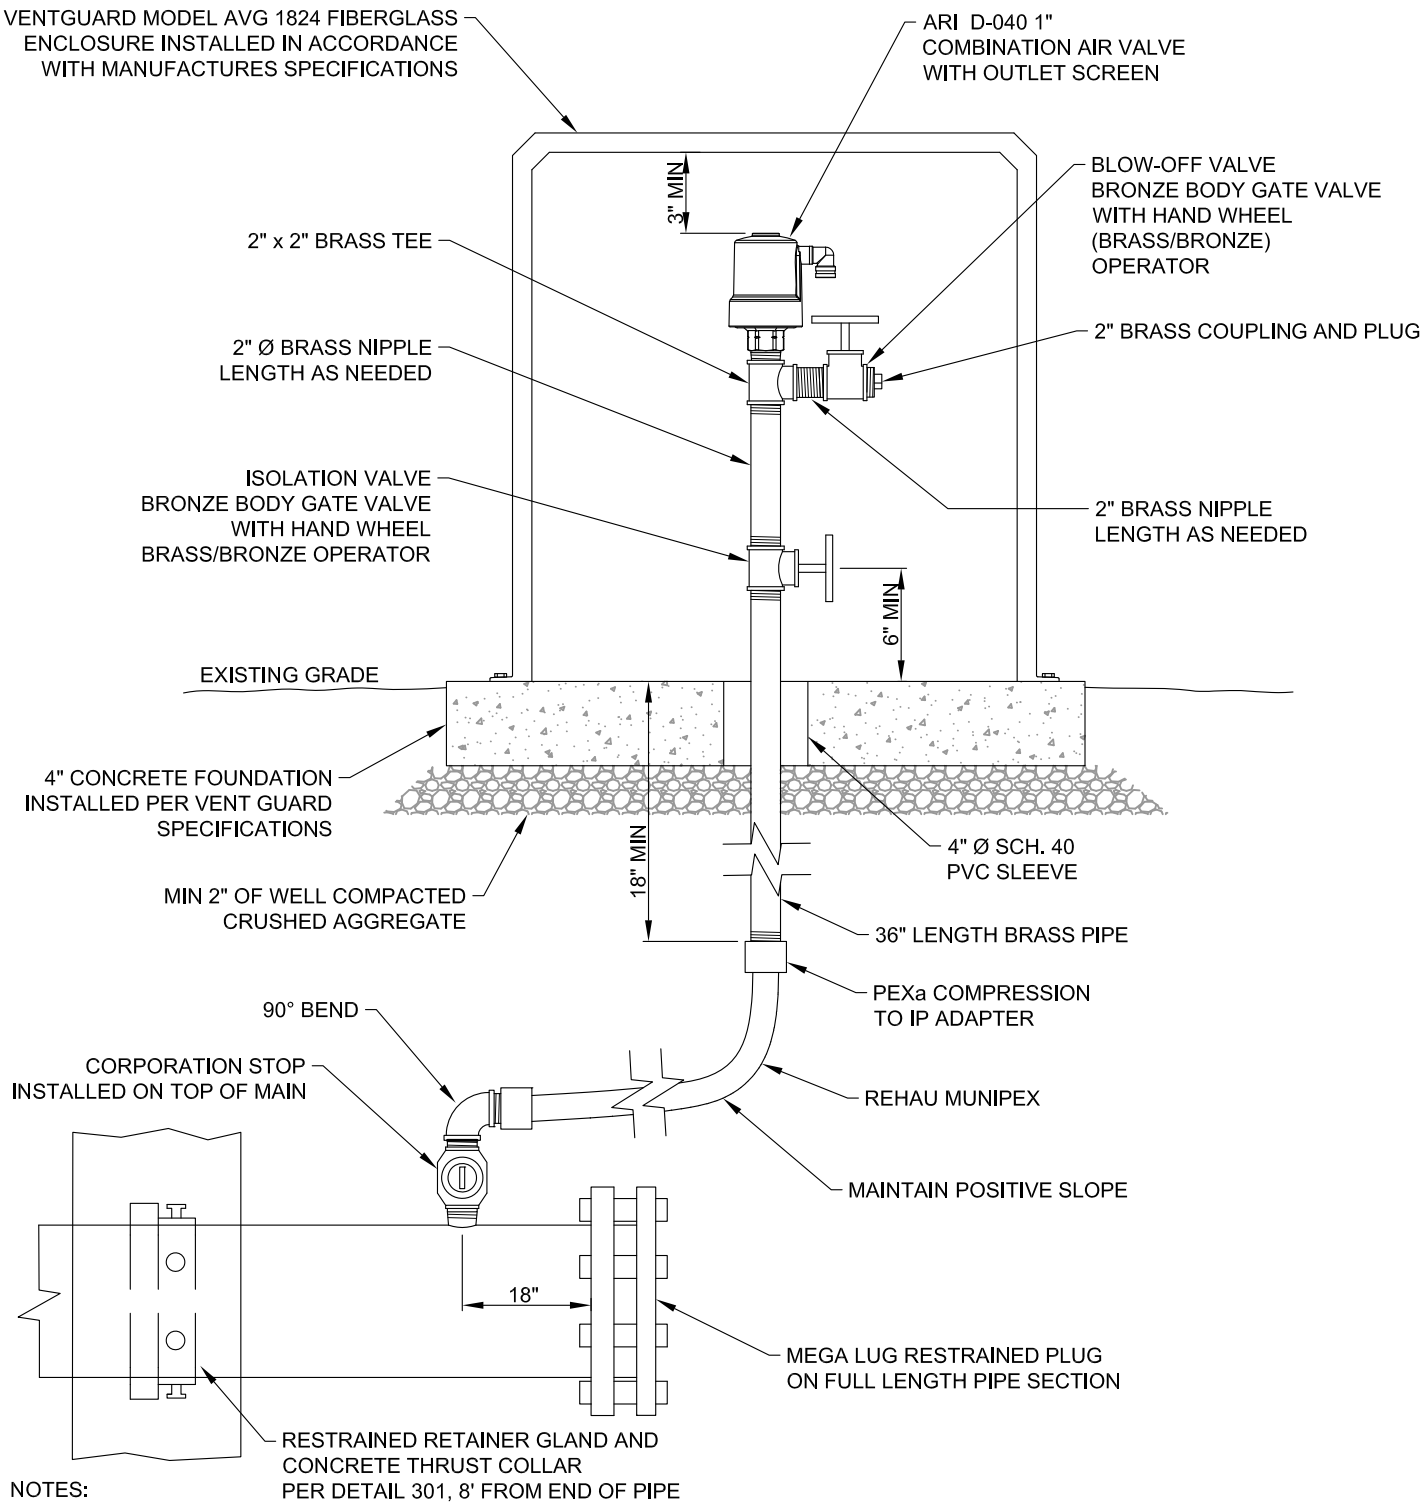

NOTES:

1. ENCLOSURE SHALL BE ORIENTED SO WHEN STANDING IN FRONT OF OPENING THE ISOLATION VALVE IS LOCATED AT 3 O-CLOCK LOOKING DOWN. BLOW-OFF VALVE ALWAYS AT 5 O-CLOCK LOOKING DOWN.
2. ALL COMPONENTS INSIDE ENCLOSURE SHALL BE WRAPPED WITH FOIL BACKED FIBERGLASS PIPE INSULATION.
3. ALL POLY SERVICE LINE MUST HAVE A TRACER WIRE THAT RUNS FROM THE POINT OF CONNECTION AT THE MAIN TO THE INSIDE OF THE FIBERGLASS ENCLOSURE.
4. CONNECT TRACER WIRE TO CORP BY STRIPPING END AND WRAPPING AROUND CORP COMPLETELY COVER STRIPPED END BY WRAPPING WITH 30 MIL TAPE.

CITY OF CORVALLIS

ENGINEERING DIVISION

COMBINATION AIR RELEASE DEAD END MAIN BLOW-OFF

DATE: JANUARY 2020	SCALE: NONE	STANDARD DETAIL No.
APPROVED:		305A