


VERTICAL FACE WITH COLD  
JOINT WHERE VALLEY GUTTER  
ABUTS CONCRETE AS DIRECTED.

PROVIDE 1" BATTER  
WHERE GUTTER FACE  
TO BE PAVED  
AGAINST WITH HMAC

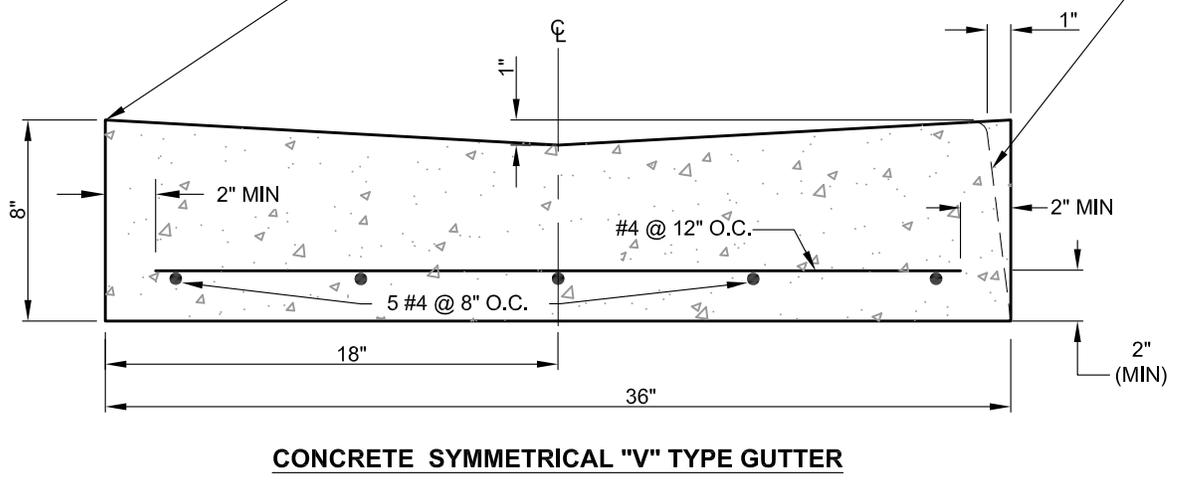

**NOTES:**

1. BAR REINFORCEMENT REQUIRED IN VALLEY GUTTERS ONLY WHEN USED AS PART OF COMMERCIAL DRIVEWAYS, INTERSECTIONS, OR WHEN HEAVY TRUCK TRAFFIC IS EXPECTED.
2. CONCRETE SHALL ATTAIN A 28 DAY MINIMUM COMPRESSIVE STRENGTH OF 4000 P.S.I.
3. THE TOTAL WIDTH OF THE NON-SYMMETRICAL "V" GUTTER MAY BE REDUCED TO 30" WHEN CONSTRUCTED WITH A CURB-EXTRUSION MACHINE.
4. CONTRACTION JOINTS SHALL BE PLACED AT APPROXIMATELY 15 FT INTERVALS AND SHALL EXTEND A MINIMUM OF 50% THROUGH THE GUTTER PAN THICKNESS.

<b>CITY OF CORVALLIS</b>		
ENGINEERING DIVISION		
<b>VALLEY GUTTER</b>		
DATE: JANUARY 2020	SCALE: NONE	STANDARD DETAIL No.
APPROVED: <i>EB</i>		<b>104</b>