


CLEANOUT PIPE SIZE SHALL CONFORM TO SEWER MAIN PIPE SIZE UP TO 12" I.D. PIPE - FOR SEWER MAINS OVER 12" I.D. A 12" CLEANOUT SHALL BE USED - A MANUFACTURED PIPE ADAPTOR SHALL BE USED WHEN CHANGING PIPE SIZE


TRACER WIRE
SEE STANDARD DETAIL NO. 201

4 FOOT MINIMUM DEPTH
OR AS SPECIFIED

CLEANOUT PIPE AND FITTINGS SHALL BE THE SAME MATERIAL AS THE MAIN PIPE

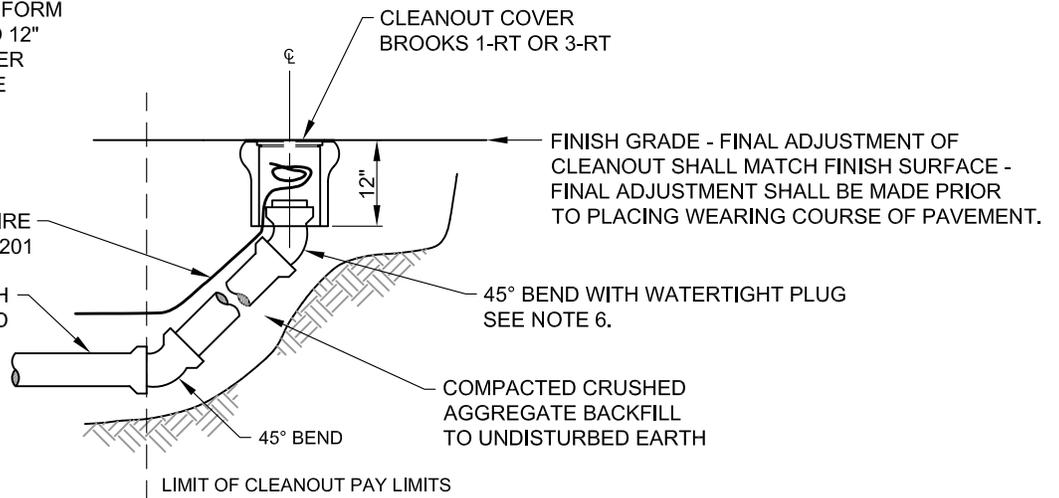

STANDARD CLEANOUT DETAIL
(FOR END OF SANITARY MAIN WITH FOUR OR LESS SERVICE CONNECTIONS)

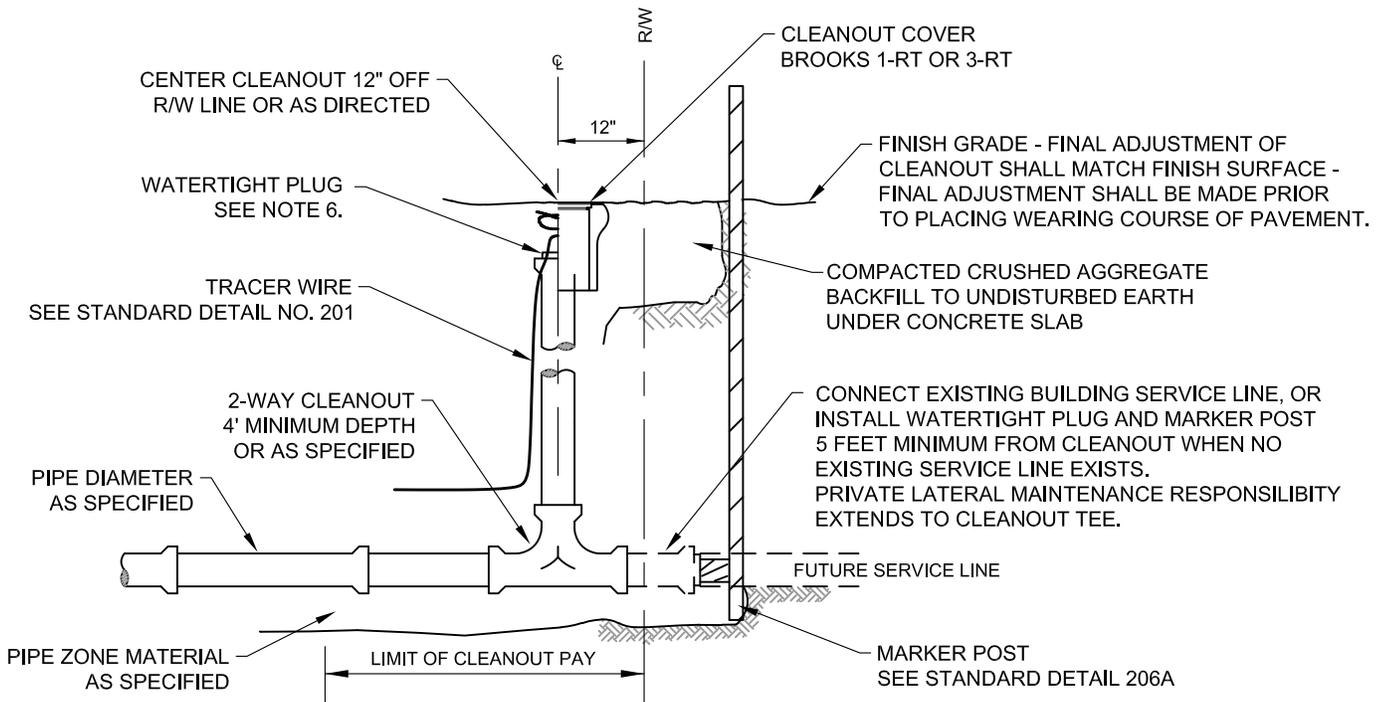

STANDARD SERVICE LATERAL CLEANOUT DETAIL

NOTES:

1. SEE DETAIL 206A FOR STANDARD MAIN PIPE CONNECTION DETAILS.
2. MARKER POSTS AND BLOCKING FOR END OF LINE SHALL BE A PRESSURE TREATED 2x4. POST SHALL EXTEND 12" ABOVE FINISH GRADE AND PAINTED WHITE.
3. CLEANOUTS OUTSIDE OF PAVED AREA SHALL BE IDENTIFIED WITH GALVANIZED MARKER POST PER STANDARD DETAIL 207 AS DIRECTED BY ENGINEER. A 2'x2'x4" CONCRETE PAD SHALL BE PLACED AROUND CLEANOUT BOX.
4. GLUE-ON OR SOLVENT WELDED PLUGS SHALL NOT BE PERMITTED.
5. MIN. DEPTH AT RIGHT-OF-WAY LINE SHALL BE 4 FT. OR AS SPECIFIED.
6. ALL CLEANOUT STAND PIPES SHALL HAVE A WATERTIGHT PLUG WITH TABS TO PREVENT FULL PENETRATION, OLIVER TYPE OR APPROVED EQUAL. STAND PIPE MUST EXTEND UP INTO THE BOX AND TERMINATE 3" MIN 6" MAX FROM TOP OF BOX LID.

CITY OF CORVALLIS		
ENGINEERING DIVISION		
STANDARD CLEANOUT		
DATE: JANUARY 2020	SCALE: NONE	STANDARD DETAIL No.
APPROVED: <i>[Signature]</i>		206