


4" CLEANOUT (SEE STD. DETAIL 206)

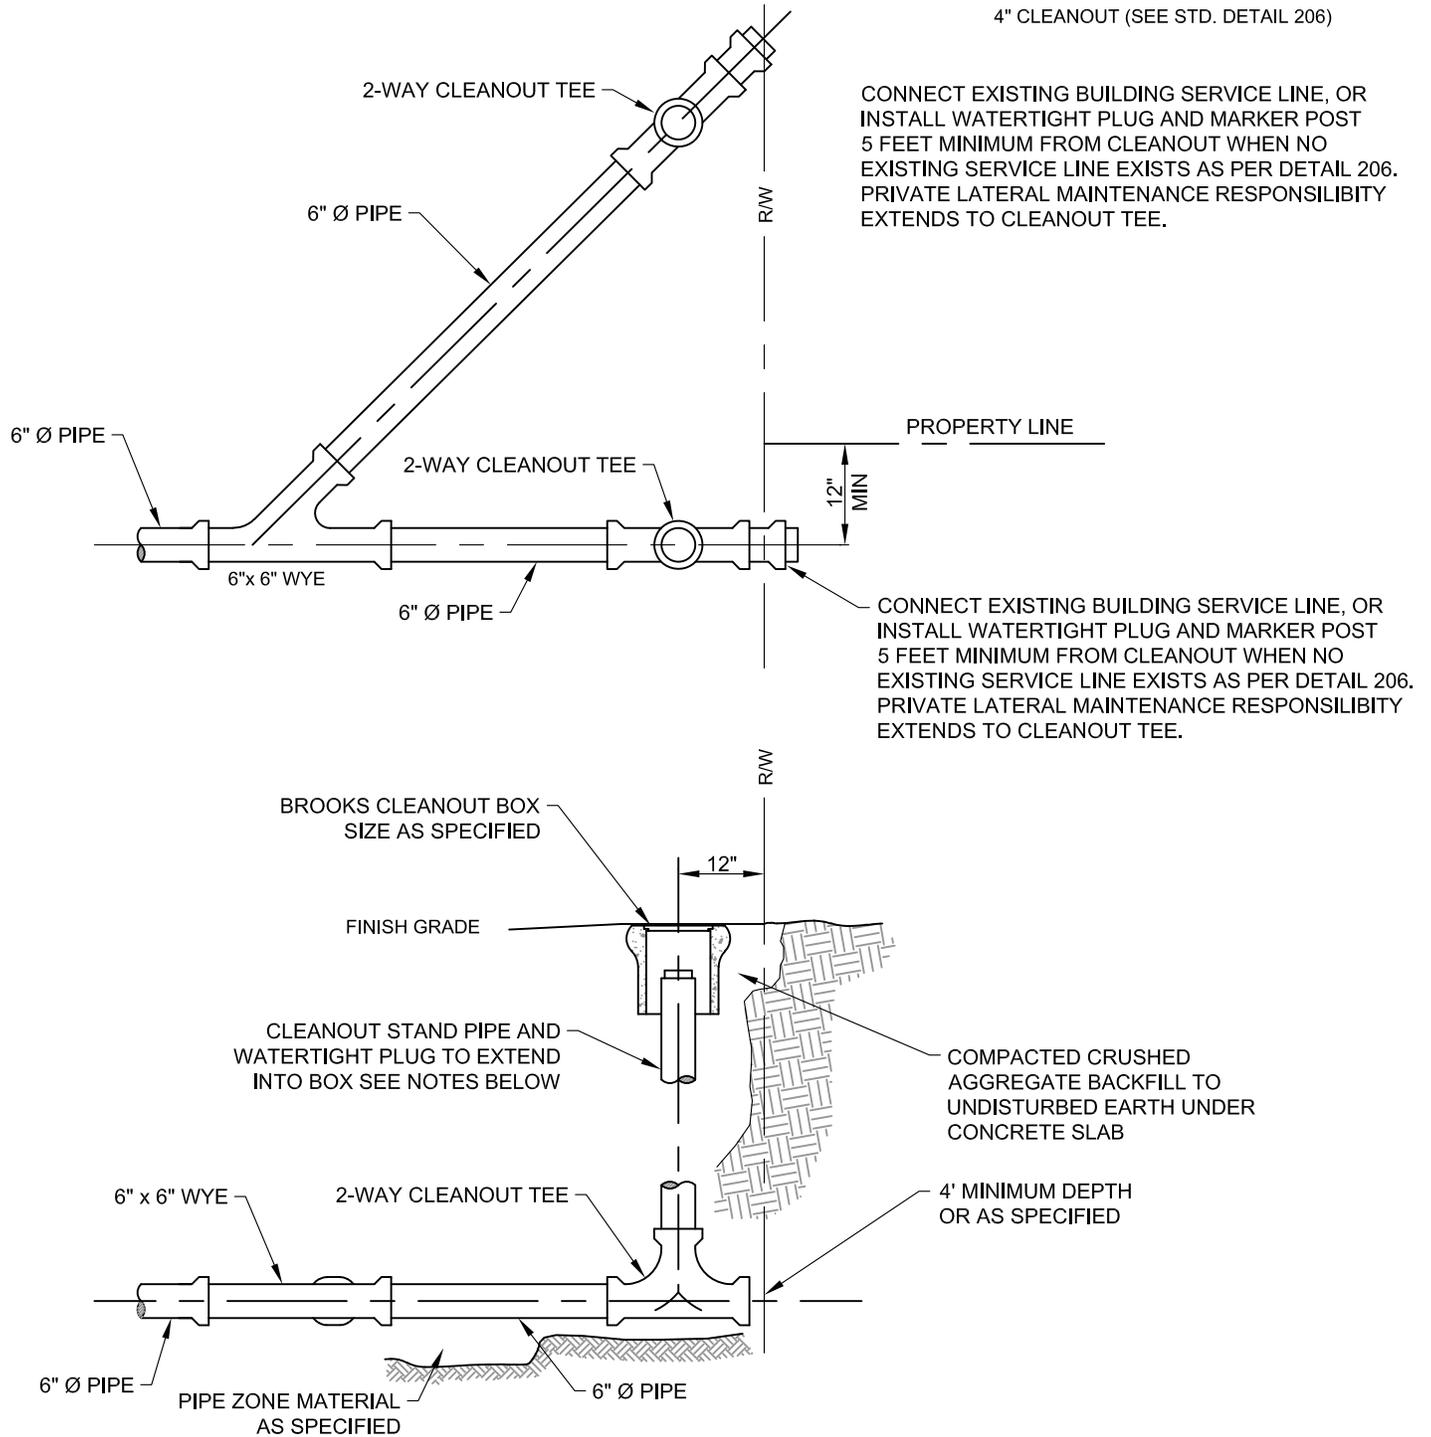

NOTES:

1. SEE DETAIL 206 & 206A FOR MAIN LINE CONNECTION AND MARKER POST DETAILS.
2. CLEANOUT STAND PIPES MUST EXTEND UP INTO THE BOX AND TERMINATE WITHIN 3" MIN OR 6" MAX FROM TOP OF BOX LID.
3. A WATERTIGHT PLUG OLIVER TYPE SHALL BE INSTALLED ON ALL CLEANOUT STAND PIPES. PLUG MUST HAVE TABS TO PREVENT FULL PENETRATION INTO PIPE.
4. FINAL ADJUSTMENT OF CLEANOUT ASSEMBLY SHALL MATCH FINISHED SURFACE GRADE AND SHALL BE COMPLETED PRIOR TO PLACEMENT OF WEARING COURSE OF PAVEMENT.
5. PROVIDE TRACER WIRE FOR ALL PIPE RUNS AS PER STANDARD DETAIL NO. 206 AND 206A.

CITY OF CORVALLIS		
ENGINEERING DIVISION		
COMMON SERVICE LATERAL		
DATE: JANUARY 2020	SCALE: NONE	STANDARD DETAIL No.
APPROVED: <i>EB</i>		206B