



SECTION A-A

ELEVATION


DETAIL A
(Anchor bolt modification, see general note 2)

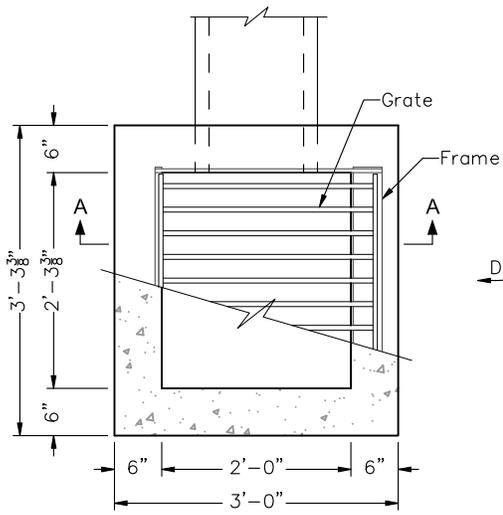

PLAN

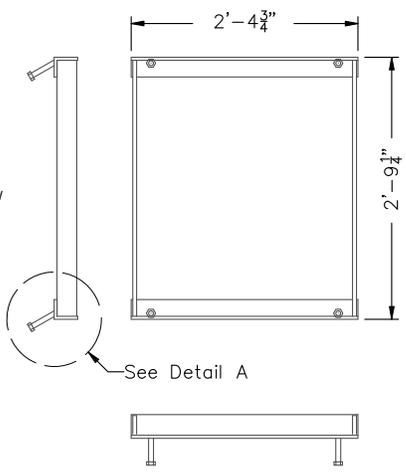

G-2 FRAME
(See general note 2)

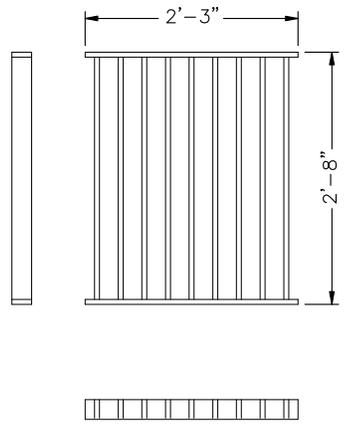

G-2 GRATE TYPE 1
(See general note 2)

NOTES:

1. CONCRETE SHALL ATTAIN A MIN. COMPRESSIVE STRENGTH OF 3000 P.S.I. IN 28 DAYS.
2. WHEN POURED IN PLACE, CATCH BASIN WALLS AND BOTTOM SHALL BE MONOLITHIC.
3. WHERE OIL / WATER SEPARATOR IS REQUIRED USE SEDIMENT TRAP PER STANDARD DETAIL 208B OR APPROVED EQUAL.
4. EXTEND TRACER WIRE INTO INLET STRUCTURE THROUGH 3/8" Ø HOLE TO BE DRILLED BY CONTRACTOR. TYP FOR ALL PIPE RUNS ENTERING STRUCTURE. LEAVE ENOUGH FREE WIRE TO EXTEND 18" ABOVE GRATE. SEE STANDARD DETAIL NO. 201 FOR TRACER WIRE SPECIFICATIONS.

CITY OF CORVALLIS		
ENGINEERING DIVISION		
STANDARD DITCH INLET		
DATE: JANUARY 2020	SCALE: NONE	STANDARD DETAIL No.
APPROVED: <i>[Signature]</i>		210